

# Radon Measurement Report



## PROPERTY INFORMATION



Property Name	QC
Street Name:	
City:	West Windsor
State/Province/Territory:	VT
Postal/ZIP Code:	05062
Country:	United States
Ventilation Type:	None
Building Type:	House
Foundation Type:	Basement Foundation
Radon Mitigation System:	Passive

## MEASUREMENT SUMMARY

### RADON LEVEL

0.2 pCi/L  
MINIMUM

1.1 pCi/L  
AVERAGE

2.6 pCi/L  
MAXIMUM

### ATMOSPHERIC PRESSURE

97.2900 kPa  
MINIMUM

97.6333 kPa  
AVERAGE

97.7700 kPa  
MAXIMUM

### TEMPERATURE

65.5 °F  
MINIMUM

68.4 °F  
AVERAGE

69.8 °F  
MAXIMUM


### HUMIDITY

34.0 %rH  
MINIMUM


35.7 %rH  
AVERAGE

40.0 %rH  
MAXIMUM

## RADON LEVEL & AIR PRESSURE GRAPHS

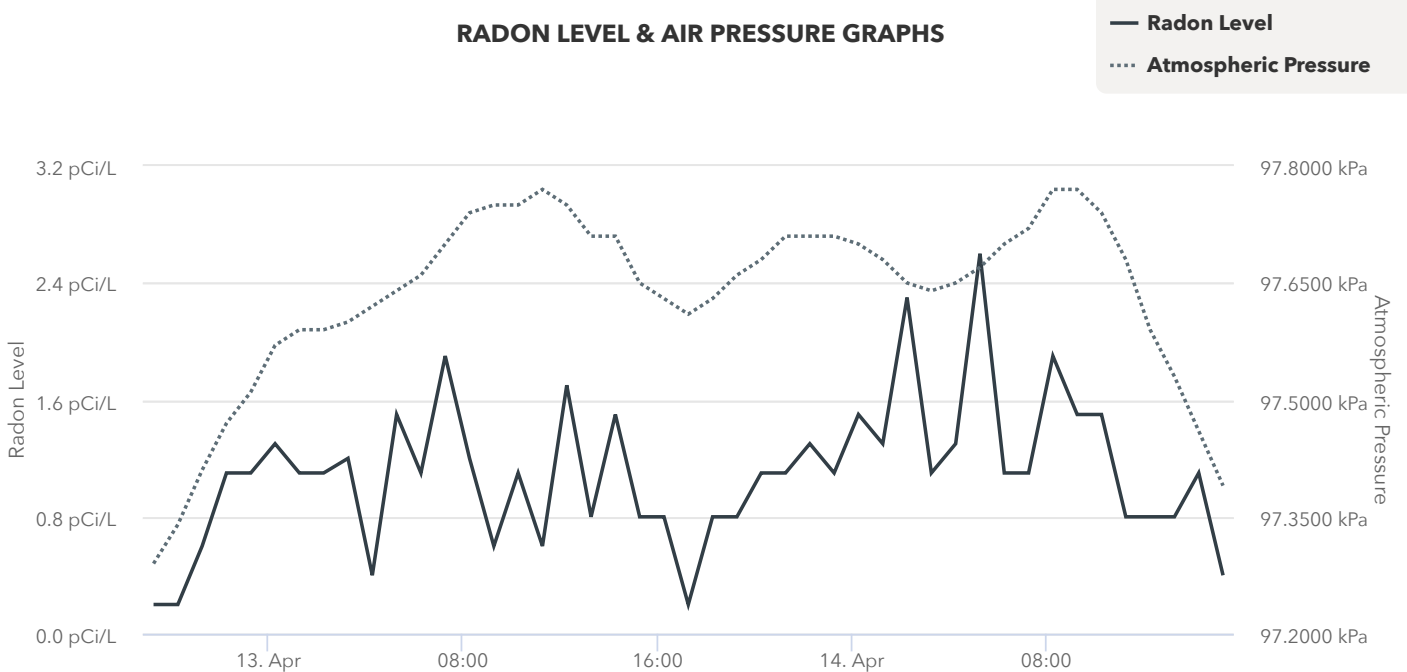

### TEMPERATURE & HUMIDITY GRAPHS

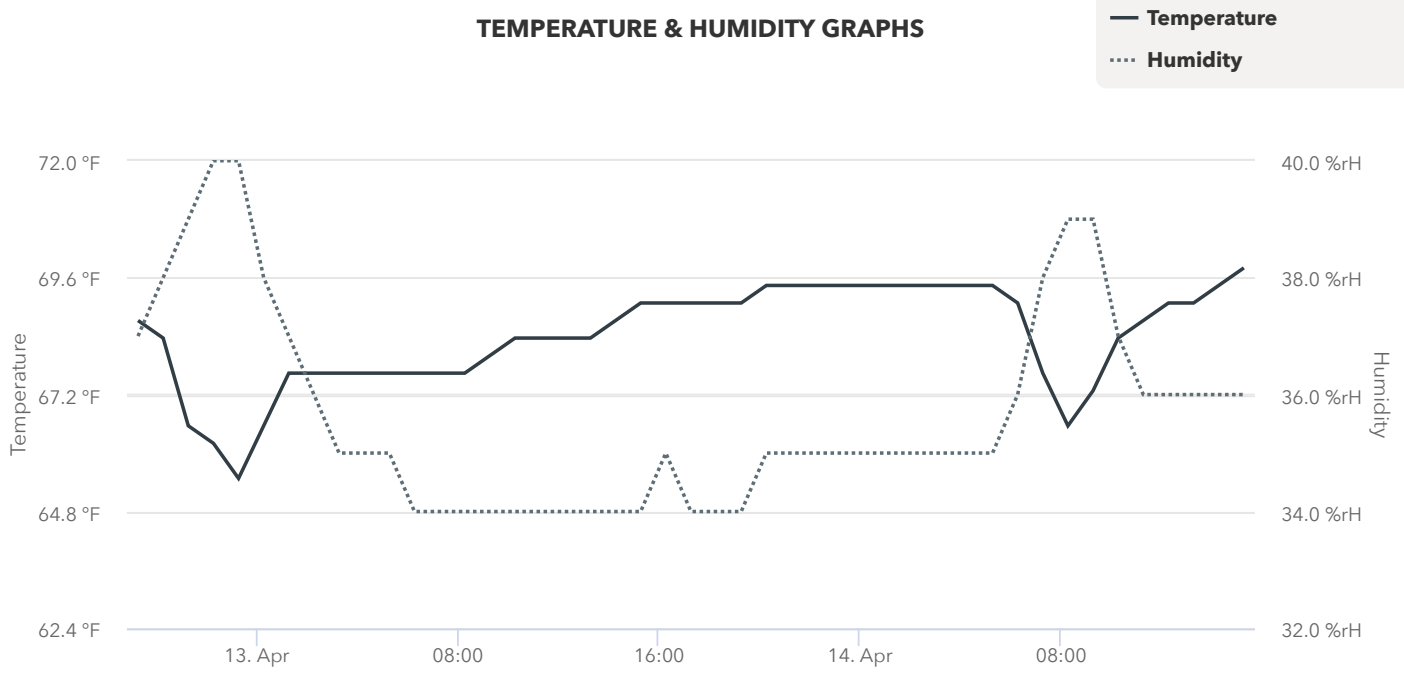

### COMPANY INFORMATION



**Name:** Art Keating  
**Phone Number:** 8029526777  
**Email:** art@vthomeinspectionsservices.com  
**Street Address:** PO 496, 1718 Rush Meadow Rd  
**City:** Brownsville  
**State/Province/Territory:** VT  
**Postal/ZIP code:** 05037  
**Country:** United States

### CERTIFICATIONS

<b>Name:</b>	<b>Number:</b>	<b>Expiration Date:</b>
Residential measurement provider	110079RT	30/09/2022

### Recommended Actions

#### <2.0 PCI/L - W/O MITIGATION SYSTEM

The measured average radon level is below the Environmental Protection Agency (EPA) Action Level of 4.0 pCi/L. The EPA recommends having this building retested at least once every 5 years to determine if a radon mitigation system is recommended at a later date since radon levels can change over time. Performing follow-up tests during the heating season is recommended since this is when radon levels tend to be the highest. A 12-month long test, or continuous monitoring, will most accurately reflect radon exposure throughout the year.

**RADON PROFESSIONAL'S SIGNATURE**

This report is certified by Art Keating.

*Art Keating*

---

Electronic Signature

2021-04-16  
West Windsor